


— ALL WIRING BETWEEN METER BASE AND DISC. MUST BE INSIDE CONDUIT.

— MAIN DISC. & MULTI-BREAKER SHALL BE INSTALLED EITHER INSIDE OR OUTSIDE OF A BUILDING OR STRUCTURE AT A READILY ACCESSIBLE LOCATION NEAREST THE POINT OF ENTRANCE OF THE SERVICE CONDUCTORS.

— DISTANCE FROM METER BASE TO MAIN DISCONNECT MUST NOT EXCEED 36"

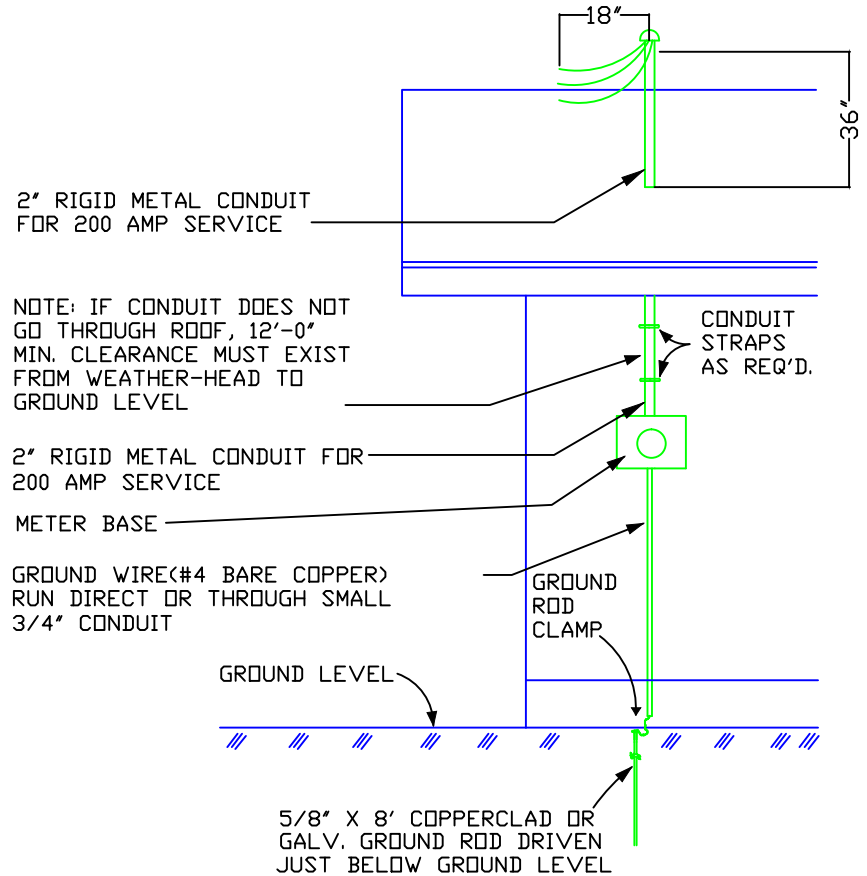

* CUSTOMER GROUNDING SHALL BE IN ACCORDANCE WITH THE CURRENT ADDITION NATIONAL ELECTRICAL CODE

PERMANENT RESIDENTIAL OVERHEAD SOURCE

BEAUREGARD ELECTRIC COOPERATIVE INC.
DERIDDER, LOUISIANA 70634

*NOTIFY CITY, MUNICIPAL, OR PARISH FOR ANY CODES, PERMITS OR REQUIREMENTS APPLICABLE.

*FACILITIES SHALL COMPLY WITH NATIONAL ELECTRIC CODE (NEC)

*LA-1 CALL 1-800-272-3020
PLEASE CALL BEFORE DIGGING

NO.	DATE	BY	REVISION
1	2/26/18	DJ	REVISION
1	1/14/16	DJ	REVISION